


EM=390

LCMS Scan ESI+


Ret. Time: 4.28

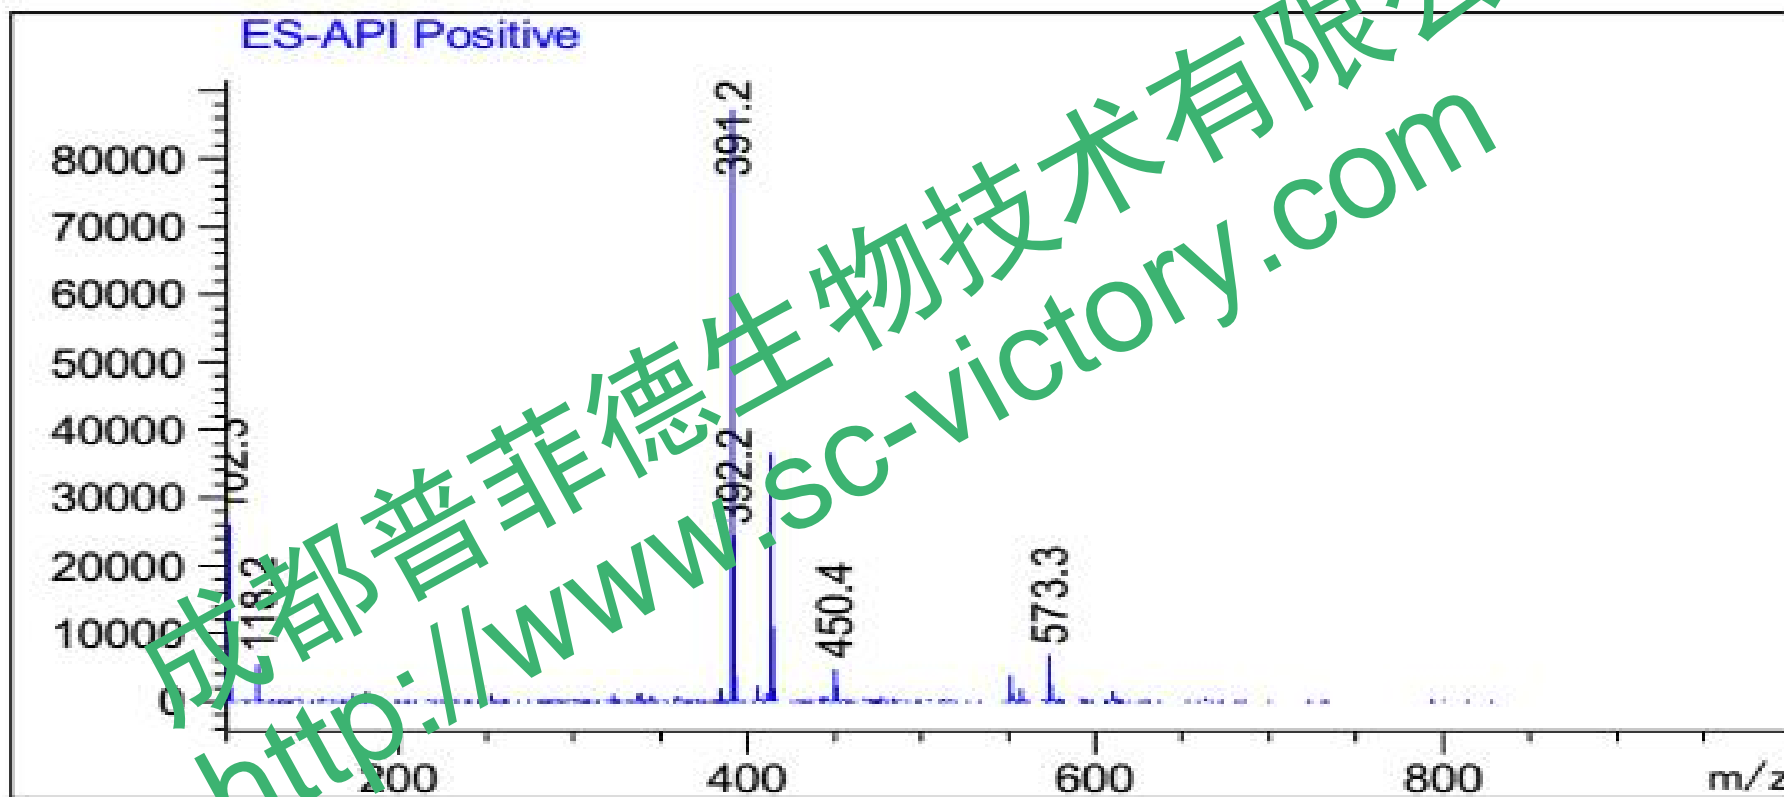

EM=390

LCMS Scan ESI-

Ret. Time: 4.28 <<<< NEGATIVE SPECTRA >>>>

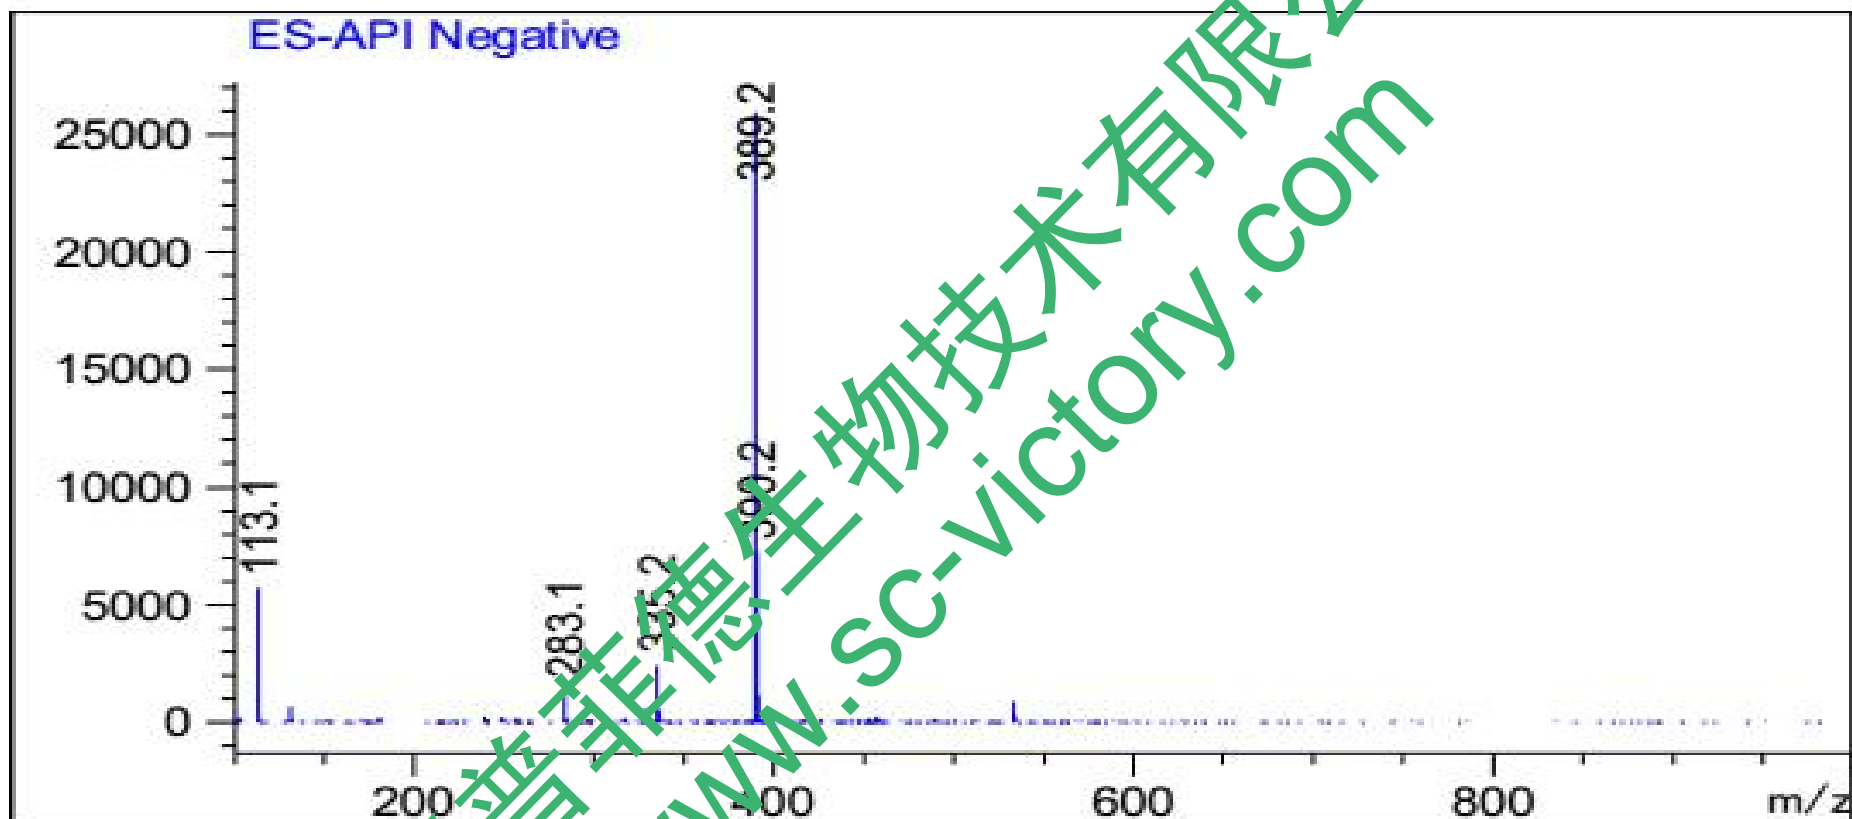

成都普菲德生物技术有限公司  
<http://www.sc-victory.com>